




SAMPLE PLOT PLAN FOR CONDENSER

Sample Plot Plan for Condenser

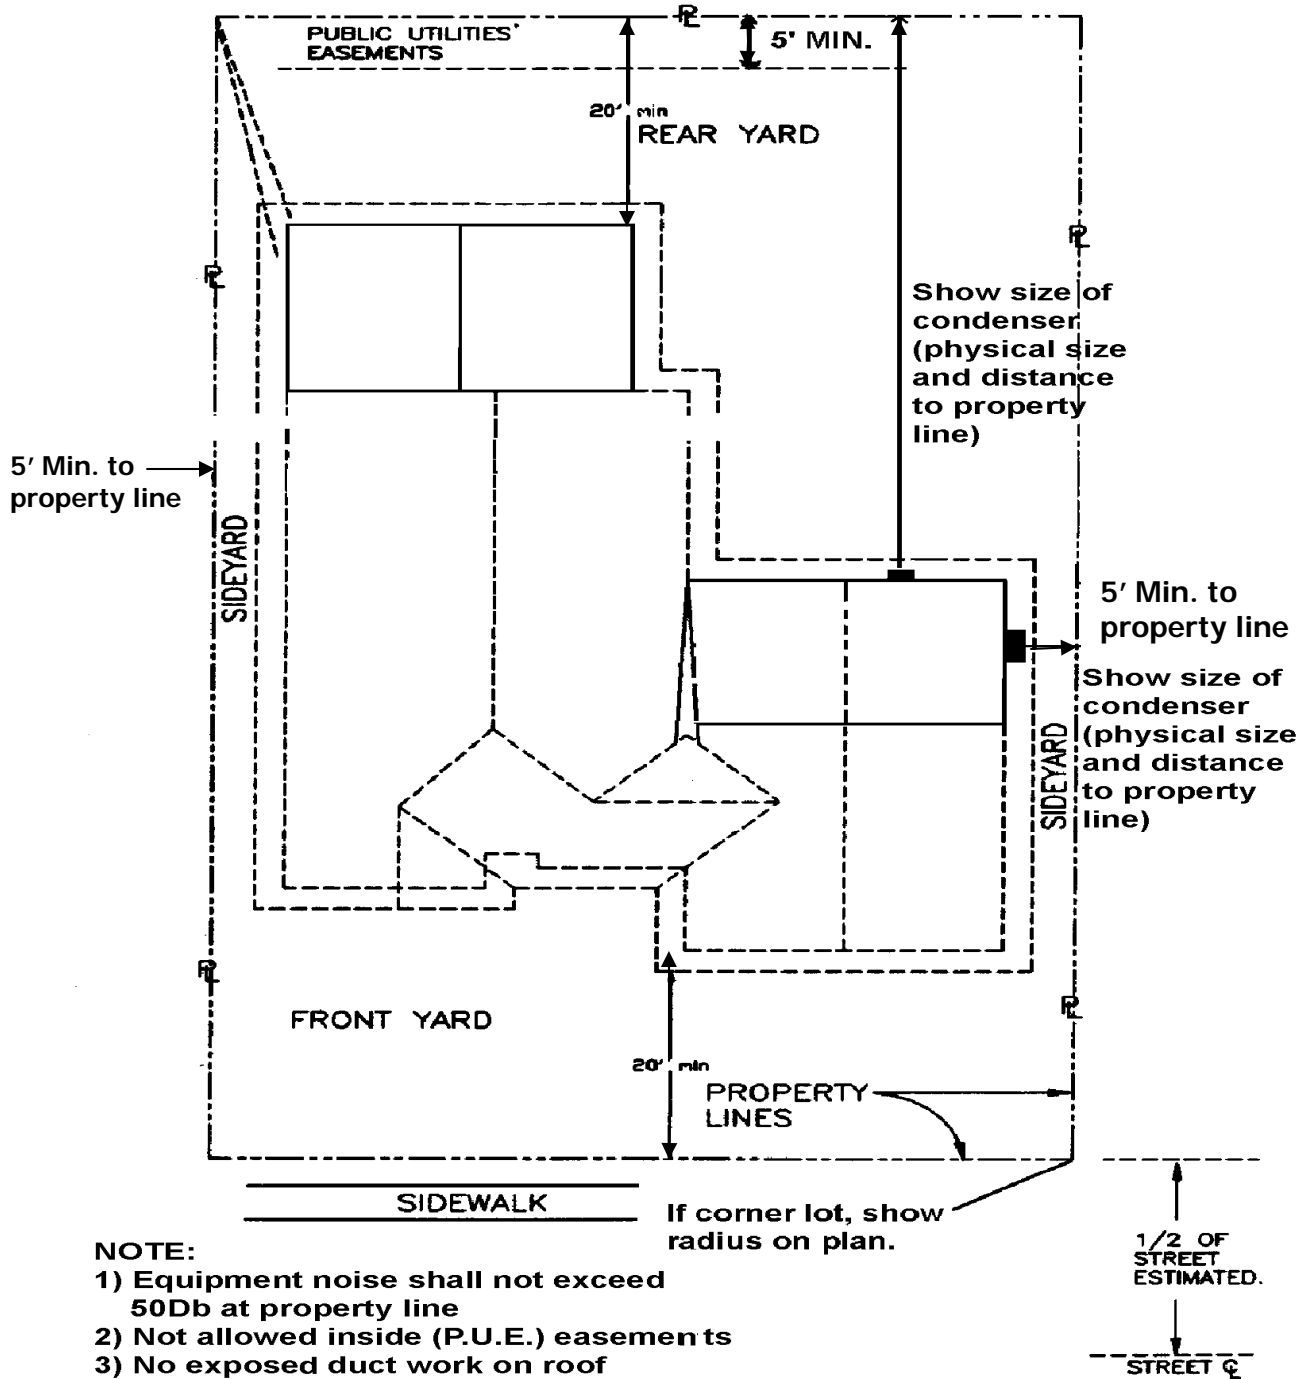

NOTE:

- 1) Equipment noise shall not exceed 50Db at property line
- 2) Not allowed inside (P.U.E.) easements
- 3) No exposed duct work on roof

Min. scale - 1/16"
 Preferable - 1/8"